



**MAXIMA + Series
ROTARY LEVEL CONTROL**



**OPERATING INSTRUCTIONS
PLEASE READ CAREFULLY**



TABLE OF CONTENTS

GENERAL SPECIFICATIONS	3
SAFETY SUMMARY	4
1.0 INTRODUCTION.....	5
2.0 INSTALLATION	5
2.1 Location and Mounting	5
2.2 Input Power and Field Wiring	6
2.3 Grounding.....	7
3.0 RELAYS	7
3.1 DPDT Relay	7
3.2 Fail-Safe High.....	7
3.3 Fail-Safe Low	8
3.4 STATUS Relay.....	8
4.0 TIME DELAY	9
4.1 Changing Time Delay	9
5.0 EXTERNAL LED	10
6.0 WARRANTY AND CUSTOMER SERVICE	10
7.0 DISPOSAL	10
EUROPEAN DECLARATION OF CONFORMITY	11





MAXIMA + GENERAL SPECIFICATIONS

Supply:	AC MODEL DC MODELS	24/115/230 VAC 50/60 Hz (selectable) 12 VDC Model or 24 VDC Model
Supply Tolerance:		-15% +10%
Load:		AC Model = 8 VA; DC Models = 4 VA
External Overcurrent Protection:	AC MODEL DC MODELS	24 VAC = 750 mA; 115 VAC = 200 mA; 230 VAC = 100 mA internally protected, no external fusing required
Ambient Temperature: (Electronics)		-40° F to +158° F (-40° C to +70° C)
Enclosure:		Type 4X, 5, 9, & 12 (HAZ LOC CL II E, F, & G)
DPDT Relay Output:		10 Amps 250 VAC
Fail-Safe:		Switch selectable "High" or "Low" level modes.
Status Indicator Relay:		SPDT = 10A 250 VAC (optional) DC Solid State Relay = 1 A 42 VDC (optional) AC Solid State Relay = 1 A 250 VAC
Time Delay:		Selectable 5 seconds (default); programmable to 25 seconds
Mounting:		1 1/4" NPT
Conduit Entry:		3/4" NPT



SAFETY SUMMARY

Review the following safety precautions to avoid injury and prevent damage to the equipment.

The product should be installed, commissioned, and maintained by qualified and authorized personnel only.

Install according to installation instructions and comply with all National and Local codes.

Use electrical wire that is sized and rated for the maximum voltage and current of the application.

Properly ground the enclosure to an adequate earth ground.

Observe all terminal and relay contact ratings as called out on the nameplate and in the installation manual.

Insure that the enclosure cover is in place and secured tightly during normal operation.

If this product is used in a manner not specified by the manufacturer the safety protection could be compromised.

Safety Terms and Symbols



WARNING: Warning statements identify conditions or practices that could result in injury or loss of life. Risk of electrical shock.



CAUTION: Caution statements identify conditions or practices that could result in damage to this product or other property.

Safety Precaution



CAUTION: Before removing the enclosure cover, open all circuits entering the enclosure. Be aware that there may be more than one live circuit.

1.0 INTRODUCTION

The Bin-Master Maxima + is a rotating paddle style level sensor which provides reliable point level detection for bulk solids, including powder, pellet, and granular materials. The unit's status is continually monitored, and its fail-safe circuitry will fall to a "safe" condition in the event of a unit failure or power failure. A visual LED continually indicates the sensor's status, giving a quick visual monitoring of paddle rotation, covered condition or fault condition. A Status relay is also provided for monitoring the status of the sensor.

The Maxima + motor rotates the drive shaft and paddle at 1 RPM (2RPM on 24VDC Model). When the vessel material fills to the level of the indicator paddle, the material causes the paddle to stop rotating indicating a covered condition. When the material falls away, the paddle starts rotating again to indicate an uncovered condition.

2.0 INSTALLATION

2.1 Location and Mounting

TOP MOUNT

1. Locate and cut hole in top of bin to fit outside diameter of 1 1/4" pipe coupling (1.950").
2. Position coupling halfway into bin and weld.
3. Turn unit so conduit opening is in desired location.
4. Add 1/4" extension pipe to desired length with standard 1/4" coupling on bottom end.
5. Cut 1 1/4" support pipe approximately 4" shorter than overall length of 1/4" pipe shaft when used with flexible coupling.
6. Insert 1 1/4" pipe into coupling and tighten.
7. Insert paddle into 1/4" coupling and drill holes for lock pins.

SIDE MOUNT

1. Locate and cut hole in side of bin to fit outside diameter of 1 1/4" pipe coupling.
2. Weld on half of standard 1 1/4" pipe coupling to bin wall flush with inside of bin.
3. Insert hub into coupling and turn to desired conduit position.
4. Screw paddle into place and replace lock pin.
5. Shaft and paddle should be shielded in low level mounting when subjected to material flow.
6. For side mount, a solid coupler is recommended.

Figure 1


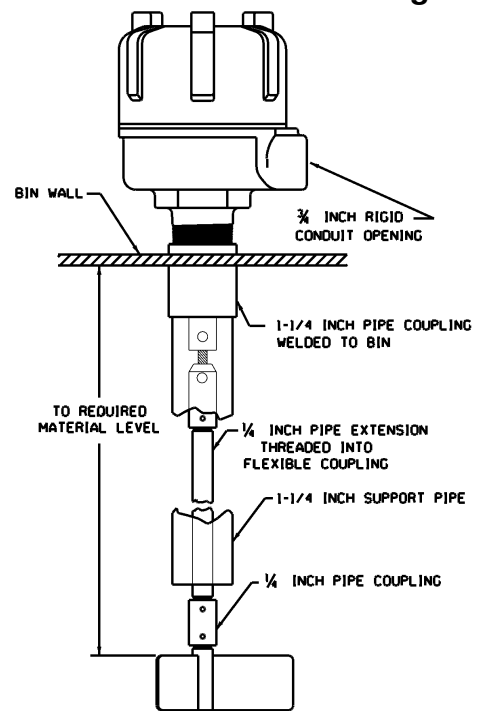


Figure 2

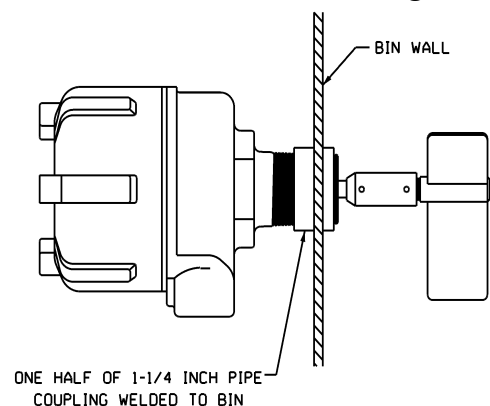

MOUNTING PLATES

Mounting plates are necessary when a completely assembled unit is to be mounted on the bin wall from the outside. A 5 1/2" hole is cut in the bin. Six bolt holes are drilled around the hole to match the mounting plate. The plate, with the unit attached, is then bolted in place. All mounting plates are available in carbon and stainless steel.

Full Coupling

For use with all Rotary level controls. This model is used for top of bin installations where shaft extensions and shaft guards are required.

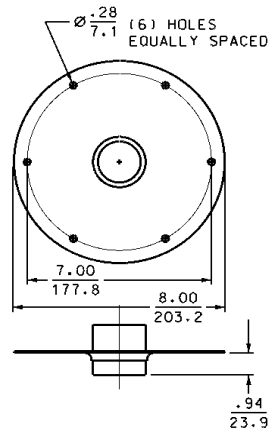


Figure 4

Half Coupling

For use with all Rotary level controls. This model is used primarily for side of bin installations.

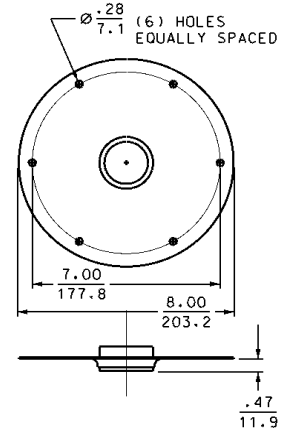


Figure 5

2.2 Input Power and Field Wiring



The MAXIMA + is available in an AC Model and 2 DC Models. See the voltage rating on the nameplate for the appropriate supply voltage. The AC Model can be powered from either a 24VAC, 115 VAC, or 230 VAC supply (see diagram below). **The Voltage selector switch must be put in the correct voltage position for the power supplied to the LINE input terminals N and L.** Field wiring should conform to all national and local electrical codes and any other agency or authority having jurisdiction over the installation. For power input, use wire that is sized and rated for the maximum voltage and current as per equipment ratings and has a temperature rating of at least 70 degrees C. For relay output, use wire that is sized and rated for the maximum voltage and current as per application, up to 250VAC 10A, and has a temperature rating of at least 70 degrees C. Installation shall be done by qualified personnel.

AC Maxima + Wiring


115 or 230 VAC Input Power

1. Confirm that the voltage Selector switch is in the correct position for the voltage applied.
2. The LINE INPUT is connected to terminals L1 and L2/N when the input voltage is either 115 VAC or 230 VAC.
3. If your circuit has a neutral conductor, connect it to the L2/N terminal. Connect the Hot conductor to the L1 terminal.
4. External Overcurrent Protection: 115 VAC = 200 mA
230 VAC = 100 mA

24 VAC Input Power

1. The 24 VAC terminals are used when the Input voltage is 24 VAC.
2. When powered from a 24 VAC system. **neither conductor can be grounded.**
3. External Overcurrent Protection 24 VAC = 750 mA

Figure 6

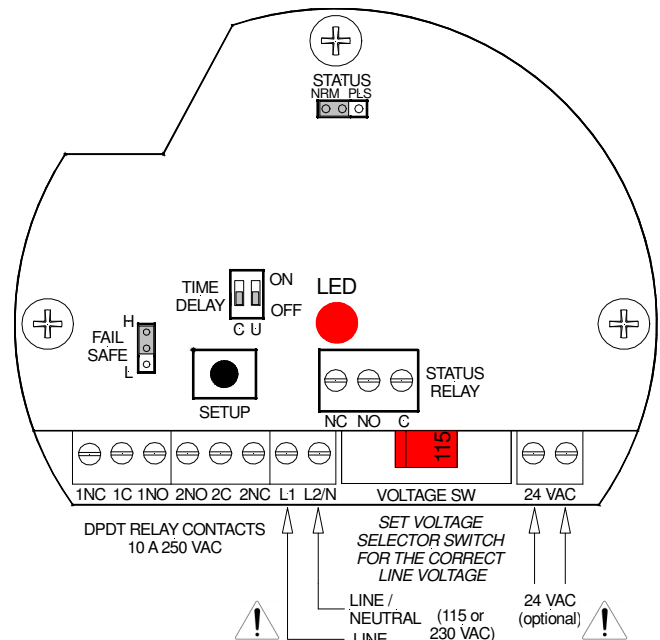


DC Maxima + Wiring

DC Maxima + units are available in either a 24 VDC or 12 VDC model.

Figure 7



1. Confirm that the DC Maxima + unit is rated for the DC voltage that is used.
2. Refer the drawing to the right for correct terminal location.
3. The positive (+) conductor of the power input is connected to the (+) terminal of the DC INPUT.
4. The negative (-) conductor of the input power is connected to the (-) terminal of the DC INPUT.

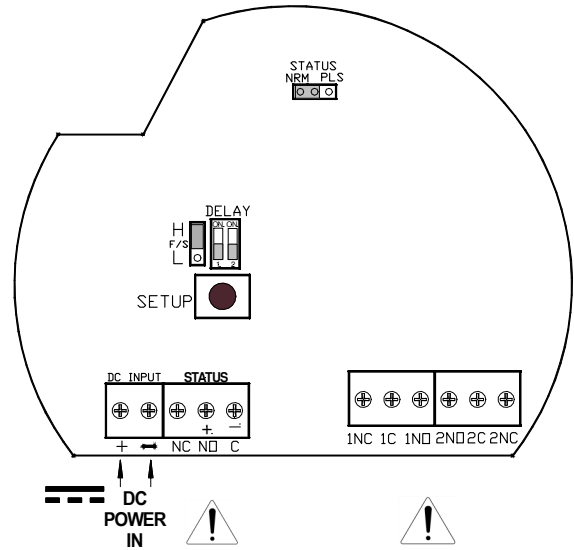

2.3 Grounding



An equipment grounding connection (earth ground) must be supplied to the unit for safety. Connect the ground conductor to the green equipment grounding screw identified in the enclosure.

3.0 RELAYS



The Maxima + has two different relays, a DPDT relay and a STATUS relay. The DPDT relay is used for covered and uncovered indication. The Status relay is used for monitoring the status of the Maxima + unit. The DPDT relay outputs may be connected to different phases, only for voltages up to 125VAC. For voltages above 125VAC, the relays shall be connected to the same phase circuit only.


3.1 DPDT Relay

The DPDT relay utilizes a Fail Safe selection jumper F/S. There are 2 positions for this jumper High (H) and Low (L). A Fail-Safe condition means that the DPDT relay contact positions are set up so that in the event of a fault condition or a power failure the relay will be de-energized and the contacts will indicate a condition that is deemed safe for the application.

3.2 Fail-Safe High

Fail-Safe High means that the relay will be energized when the paddle is rotating (uncovered) and will de-energize when the paddle is covered. In this mode, a fault condition or a power failure will cause the relay contacts to indicate that the paddle is covered, whether it is or not.


Figure 8

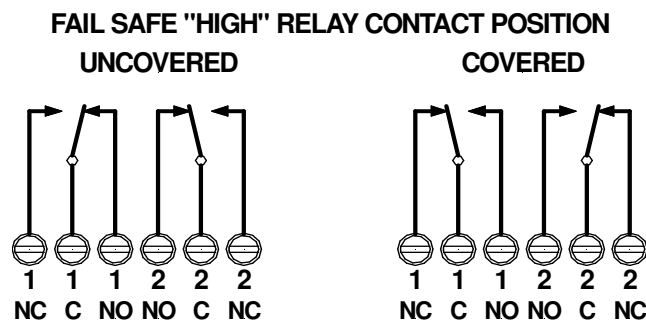

3.3 Fail-Safe Low

Fail-Safe Low means that the relay will be de-energized when the paddle is rotating (uncovered) and will energize when the paddle is covered. In this mode, a fault condition or a power failure will cause the relay contacts to indicate that the paddle is uncovered whether it is or not.

Figure 9

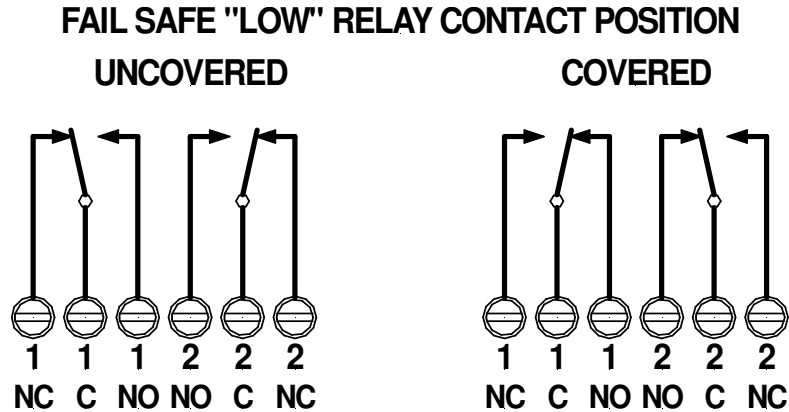


3.4 Status Relay


The Status relay indicates the status of the Maxima +. There are two modes of operation for the Status Relay, Normal (NRM) and Pulse (PLS). The mode for the Status relay is selected by the STATUS jumper at the top of the circuit board (see Figure 10).

In the NORMAL (NRM) position, the STATUS relay is energized when the Maxima + is operating correctly. In this mode the shaft rotation is monitored. If the shaft is not rotating then the "covered" switch is monitored to see if there is a covered condition. If the shaft is not rotating and the "covered switch" is not indicating cover, then the Maxima will go into a Fault condition. A Fault condition is indicated by both the STATUS relay and the DPDT de-energizing and the visual LED going off.


Figure 10

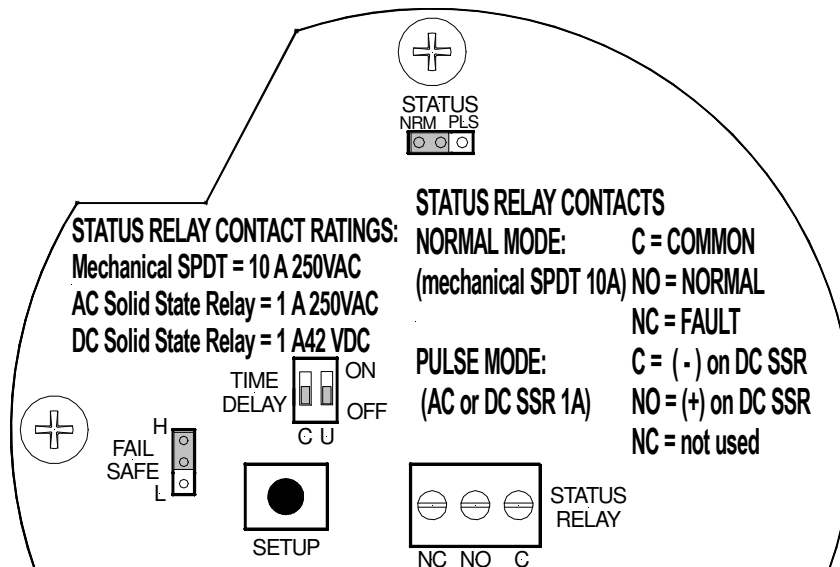

Mounting Instructions

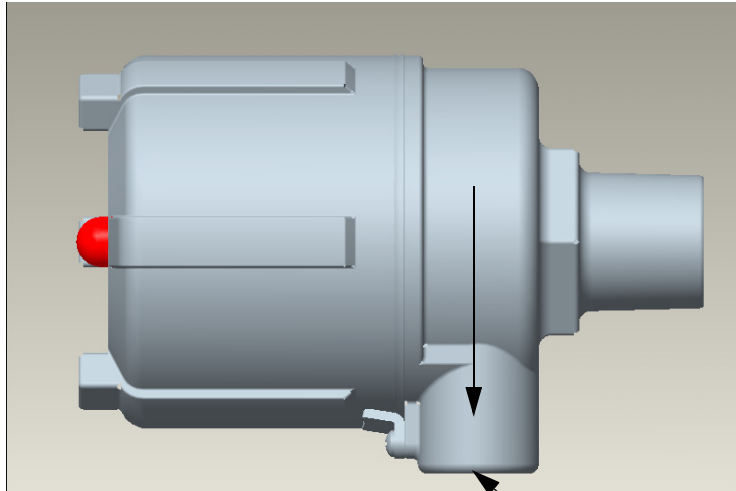

Always Mount Unit With
Conduit opening down

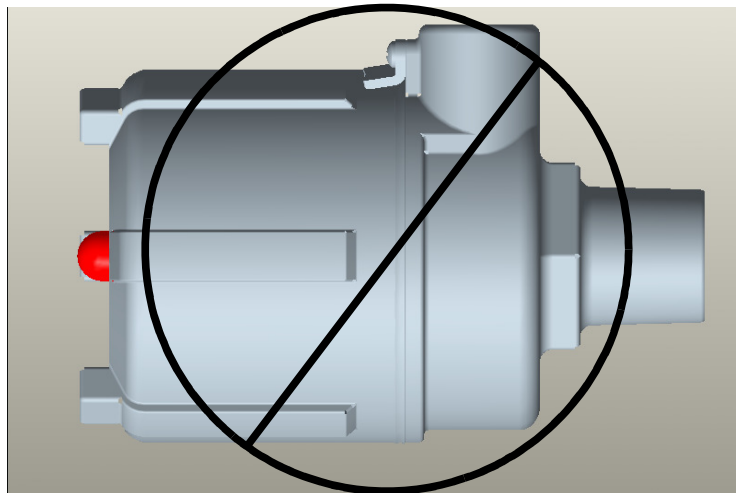

Conduit Seal

When installing this level indicator in environments where it is possible for moisture or moist air to enter the enclosure through the electrical conduit, the conduit opening should be sealed with a duct seal compound or putty appropriate for the purpose.

BINMASTER[®]